


**APPENDIX D11**

1. Cooma-Monaro Shire Council Plan No. 145 – Water Meter Installation Typical Arrangement

## WATER METER INSTALLATION

1. Water meter assemblies shall be installed in accordance with the "Typical Water Meter Arrangement" diagram below.
  - (a) Urban: Water meters shall be, unless otherwise instructed by Council, located within the property they are to serve and shall not be more than one (1.0) metre inside the property boundary.
  - (b) Rural (and Polythene Pipelines): Water meters shall be located where directed by Council, but usually, shall be located at the tapping point.
2. All pipe work between Council's water main (Tapping point) and the meter shall be of minimum Grade A copper pipe unless Council approval for the use of alternate materials has been given. Minimum cover over the pipe shall be 450mm.
3. All pipe fittings (eg. bends, sockets, tees etc) shall be manufactured from copper. Unions, meter connections and No. 13 bends shall be manufactured from brass. All fittings shall be brazed jointed with the exception of screwed fittings. Soft solder shall not be used (AS3500).
4. All work must conform with AS3500 & Local Government Regulations, 1999.
5. The meter assembly & pipe offsets shall be contained within the meter box.
6. The meter, meter cock and meter cover shall be supplied by Council at the Applicant's expense. No substitute meters or cocks will be accepted.

### TYPICAL WATER METER ARRANGEMENT

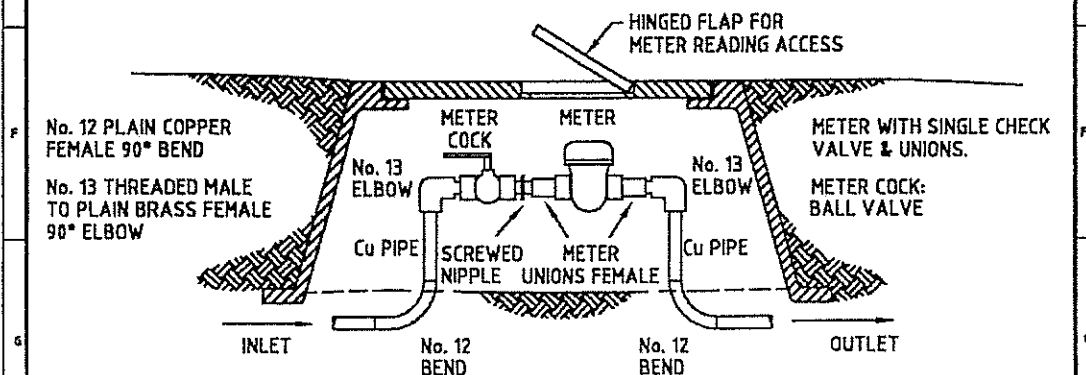

APPROVED: \_\_\_\_\_

DATE: \_\_\_\_\_

REVISIONS	C AMENDED 7.3.02		COOMA-MONARO SHIRE COUNCIL	SHEET 1 OF 1
	B REDRAWN & AMENDED JAN 99		WATER SUPPLY	PLAN NUMBER
	A AMENDED 1.3.96	D HINGED FLAP ADDED 20.5.02	WATER METER INSTALLATION TYPICAL ARRANGEMENT	A145D
	1	2	3	4