


- NOTES:**
1. ANY ONE OF THESE LAYOUTS MAYBE USED UNLESS A SPECIFIC LAYOUT IS REQUIRED BY THE ENGINEER OR THE ASSOCIATED NOTATION RESTRICTS USE.
 2. WATERMANS ARE GENERALLY TO BE LOCATED 2.4m FROM THE PROPERTY BOUNDARY (REFER SD26A) OR IN A SHARED TRENCH ARRANGEMENT (REFER SD25A) UNLESS OTHERWISE APPROVED BY THE ENGINEER.
 3. CUL-DE-SACS ALSO REFER TO OTHER TYPES OF TURNING FACILITIES SIMILAR TO THOSE SHOWN ON SD14.
 4. A MINIMUM OF 6 HOUSE SERVICES TO BE FED FROM THE LOOP SECTION OF THE MAIN IN TYPE 1 ONLY.
 5. THIS STANDARD DRAWING ONLY REFERS TO MAIN LOCATION & CONFIGURATION. FITTINGS, VALVES ETC TO BE DETERMINED TO SUIT INDIVIDUAL DESIGNS & APPROVED BY THE ENGINEER.
 6. CURVED OR FLEXIBLE PIPES MAY BE USED SUBJECT TO SPECIFIC APPROVAL BY THE ENGINEER (REFER CLAUSE 13.5.5).

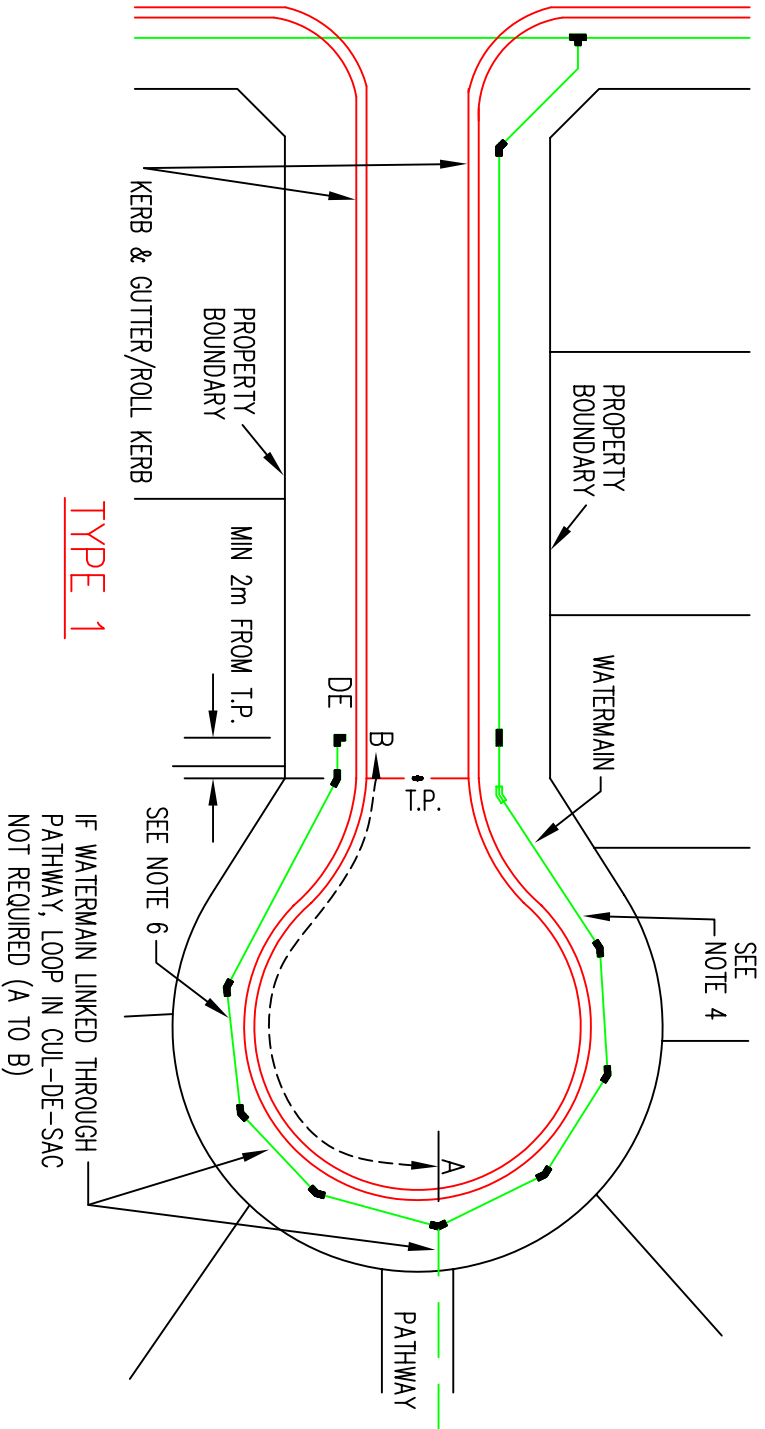

SNOWY RIVER SHIRE COUNCIL

WATERMAIN LOCATION IN CUL – DE – SACS

Surveyed By	Drawn By	Scale	Approved By	Date	Datum	Sheet No	Ref. No	Plan No
Job No	Checked By	N.T.S.						SD16a
Disk No	Passed By							