



PLAN

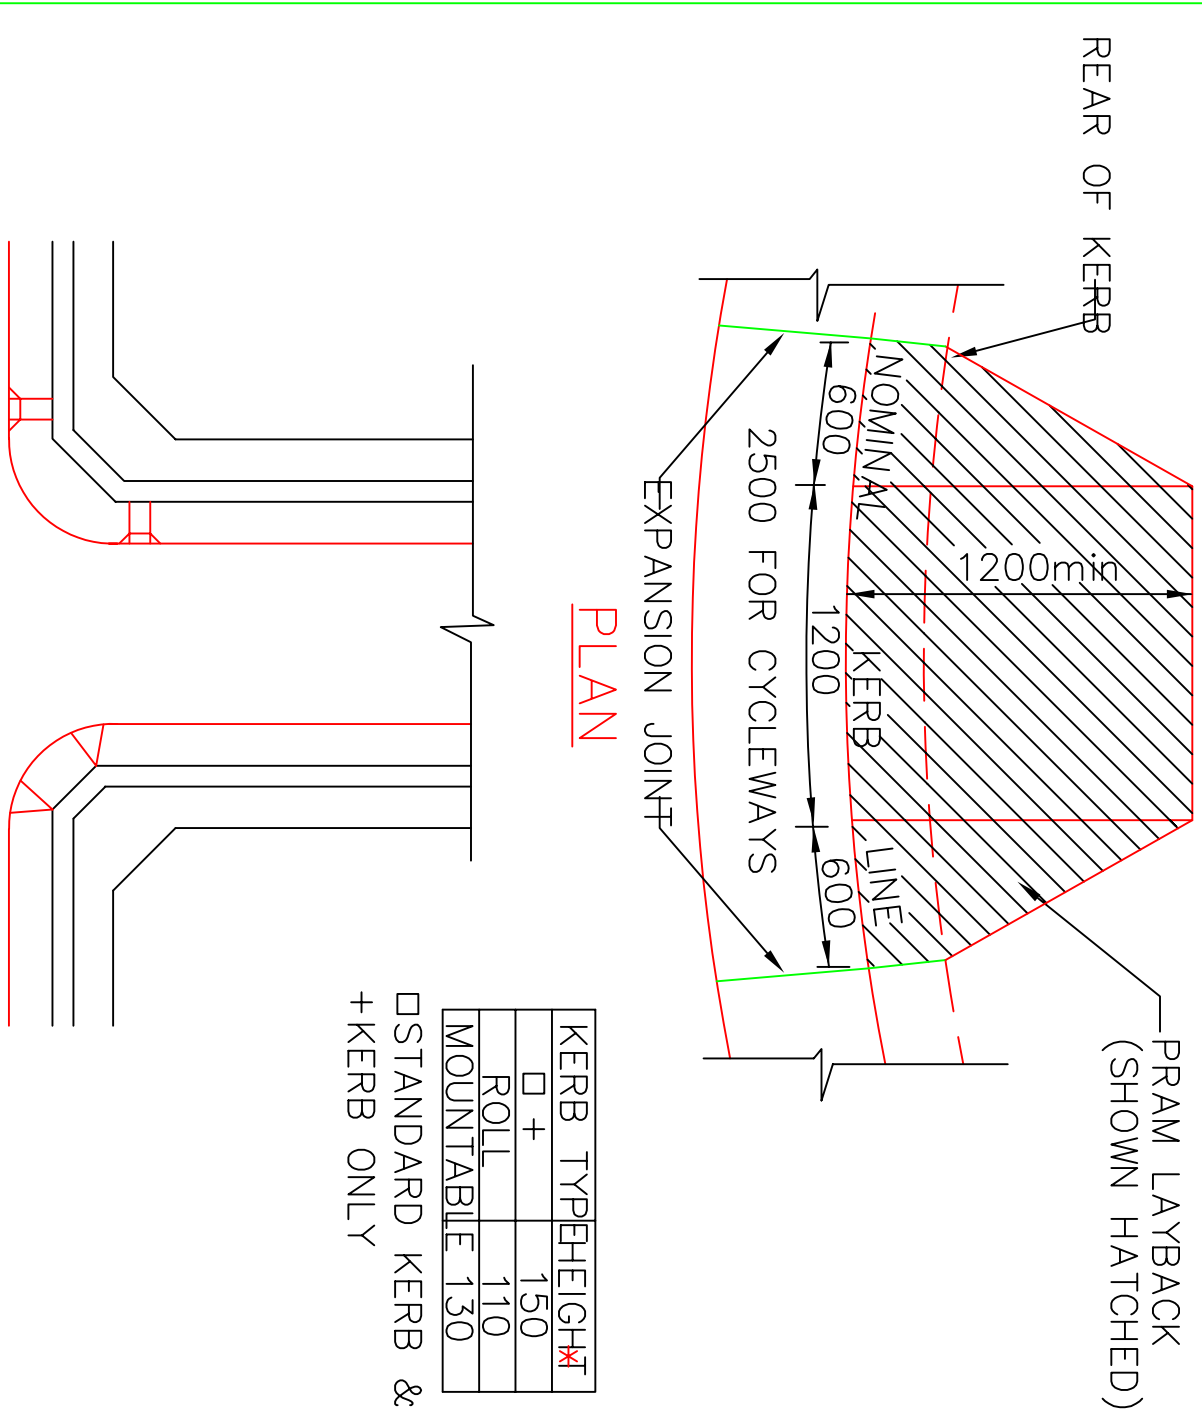

ELEVATION

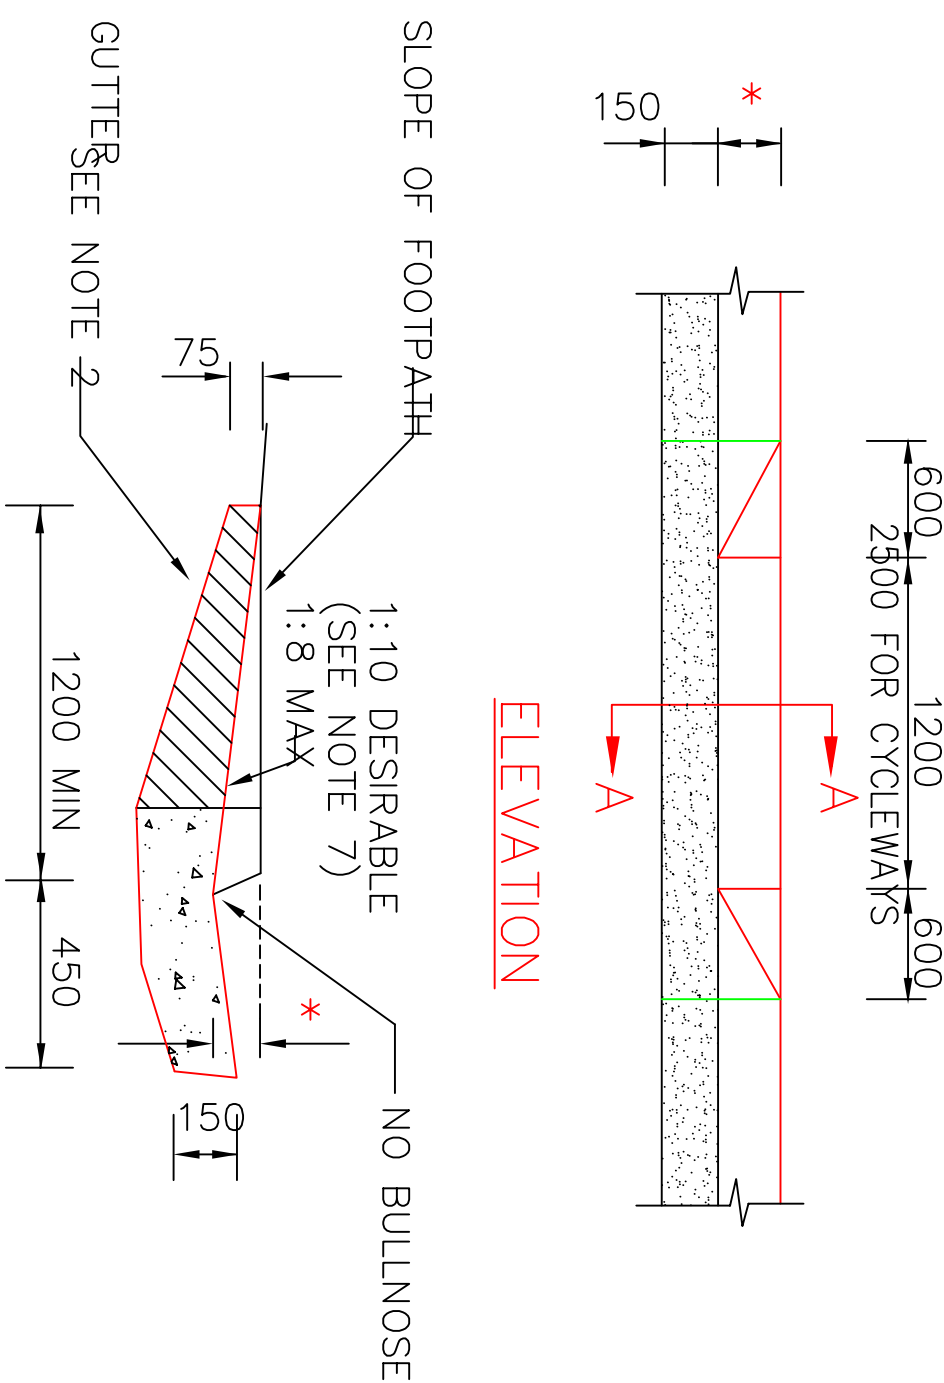

NOTES: -

- PERAMBULATOR RAMPS SHALL BE CONSTRUCTED AT ALL ROAD INTERSECTIONS & ADJACENT TO OVERLAND FLOW PATHWAYS, PARK ACCESS & WHERE NOMINATED BY THE ENGINEER.
- PERAMBULATOR RAMPS TO BE PROVIDED ON COMPACTED FINE CRUSHED ROCK, MINIMUM THICKNESS 75.
- CONCRETE TO BE OF 20 MPa COMPRESSIVE STRENGTH (F_c) AT 28 DAYS U.N.O.
- RAMP SURFACE TO BE PROVIDED WITH AN APPROVED NON-SLIP FINISH.
- RAMPS TO BE LOCATED WHERE POSSIBLE ON DOWNSTREAM SIDE OF DRAINAGE PITS.
- RAMPS TO BE PROVIDED WHERE SHOWN ON APPROVED ENGINEERING PLANS IN LIEU OF LOCATIONS SHOWN ON THIS STANDARD.
- MINOR WARPING OF THE ADJACENT FOOTPATH MAY BE REQUIRED.
- REFER TO SD5A FOR FOOTPATH, CYCLEWAY & CYCLEWAY HANDRAIL DETAILS.

SNOWY RIVER SHIRE COUNCIL

STANDARD PERAMBULATOR/CYCLWAY RAMP CROSSING

Surveyed By	Drawn By	Scale	Approved By			
Job No	Checked By		Date	Datum	Sheet No	Ref. No
Disk No	Passed By	N.T.S.				Plan No
						SD21b